

WALCHEM
5 Boynton Road
Hopping Brook Park
Holliston, MA 01746
508-429-1110

WDP400 Series Dual Input pH/ORP Controller
Quick Reference

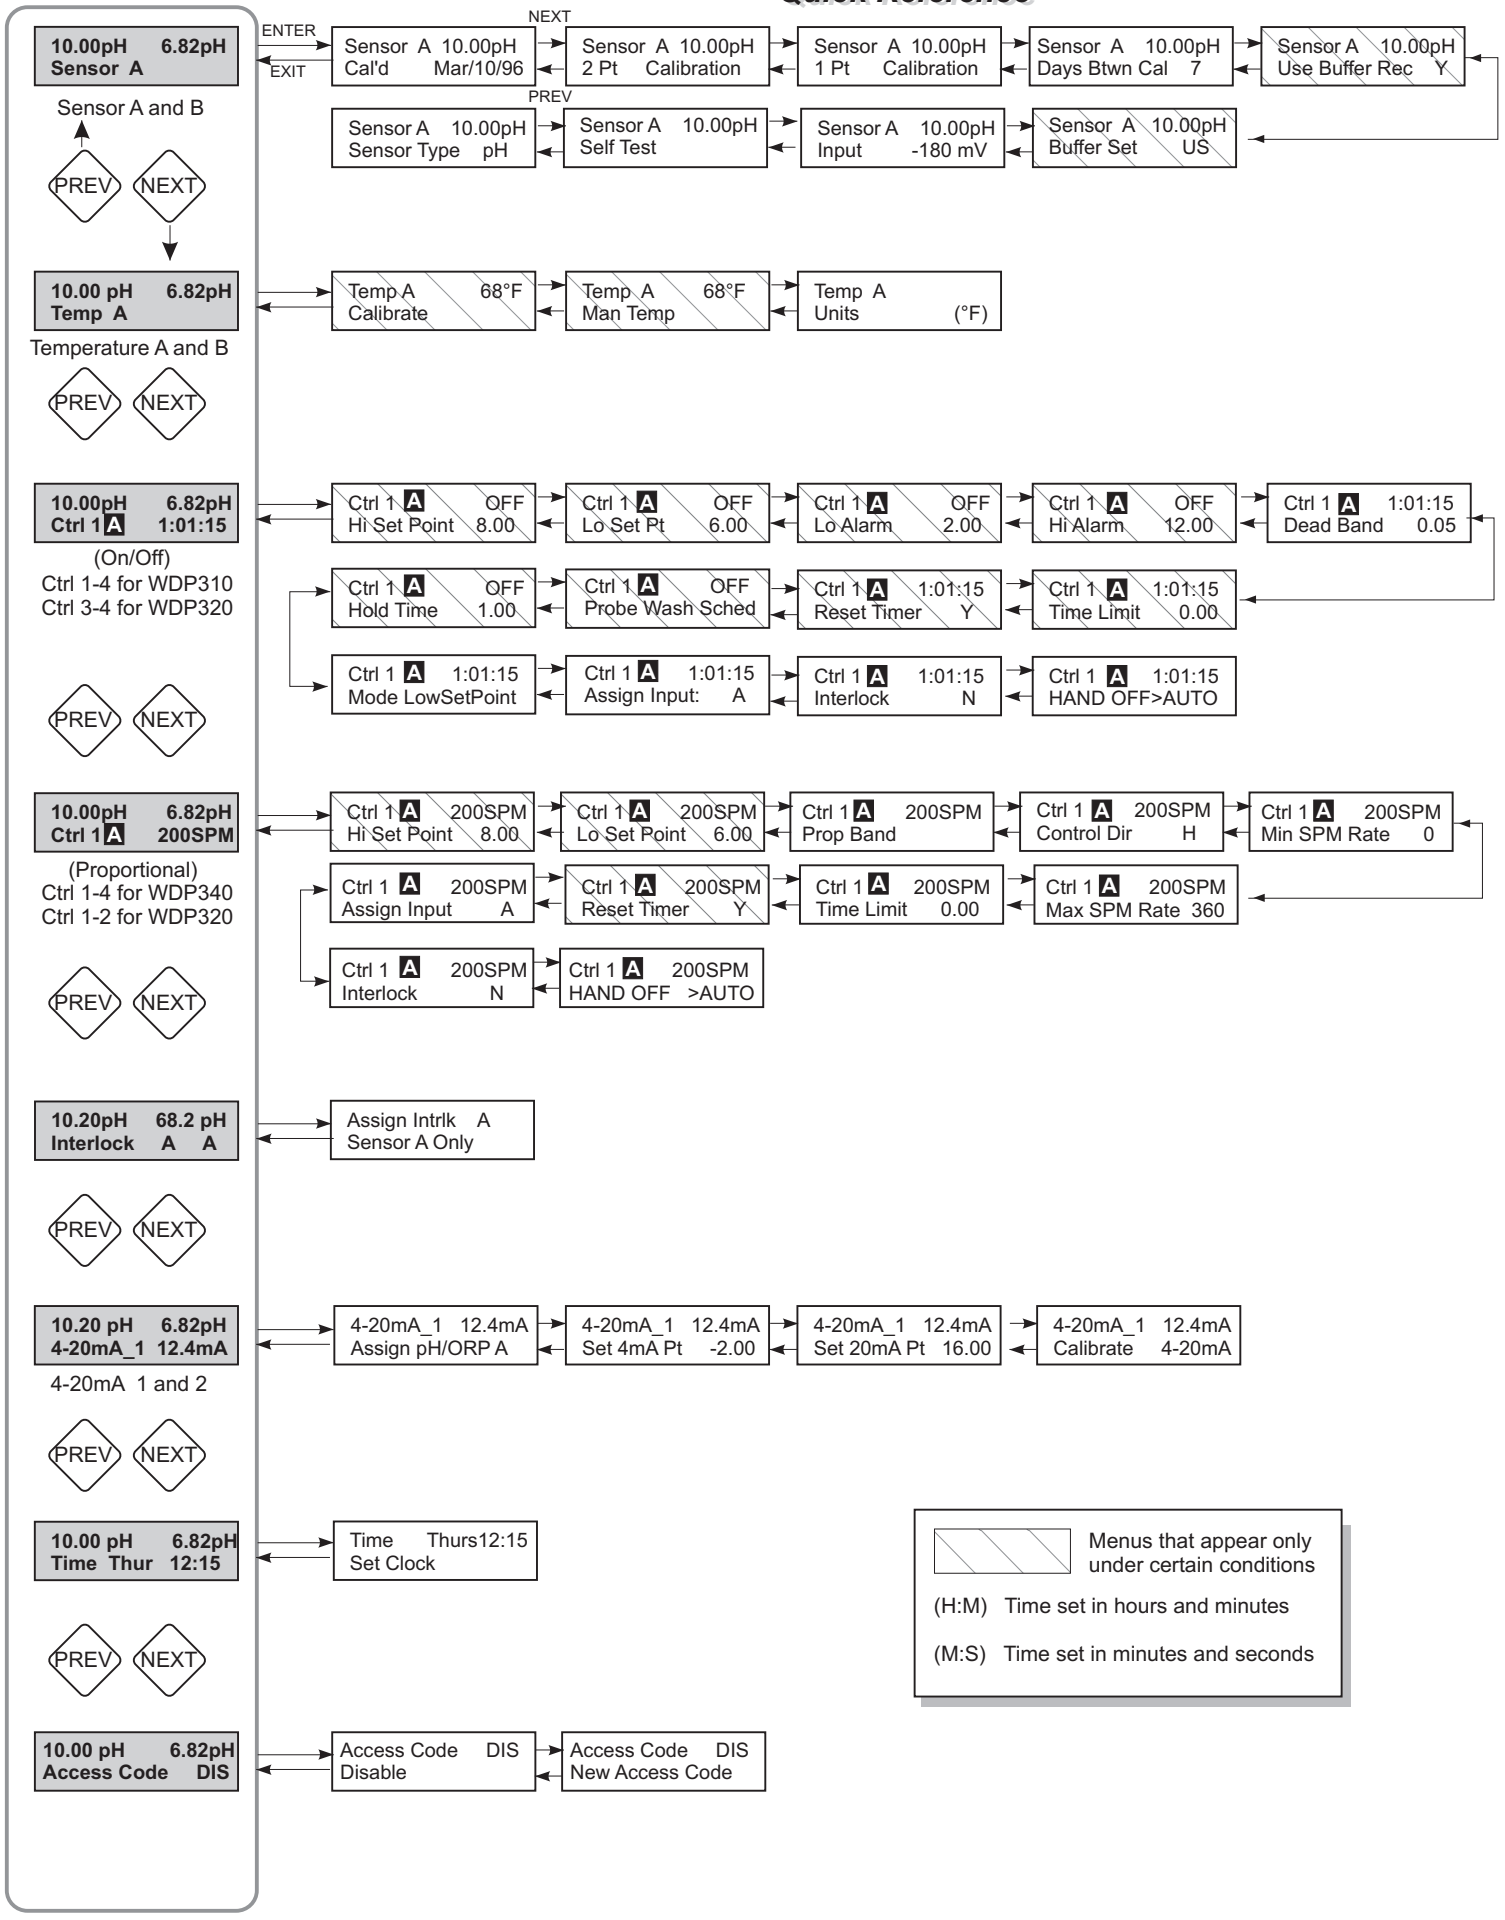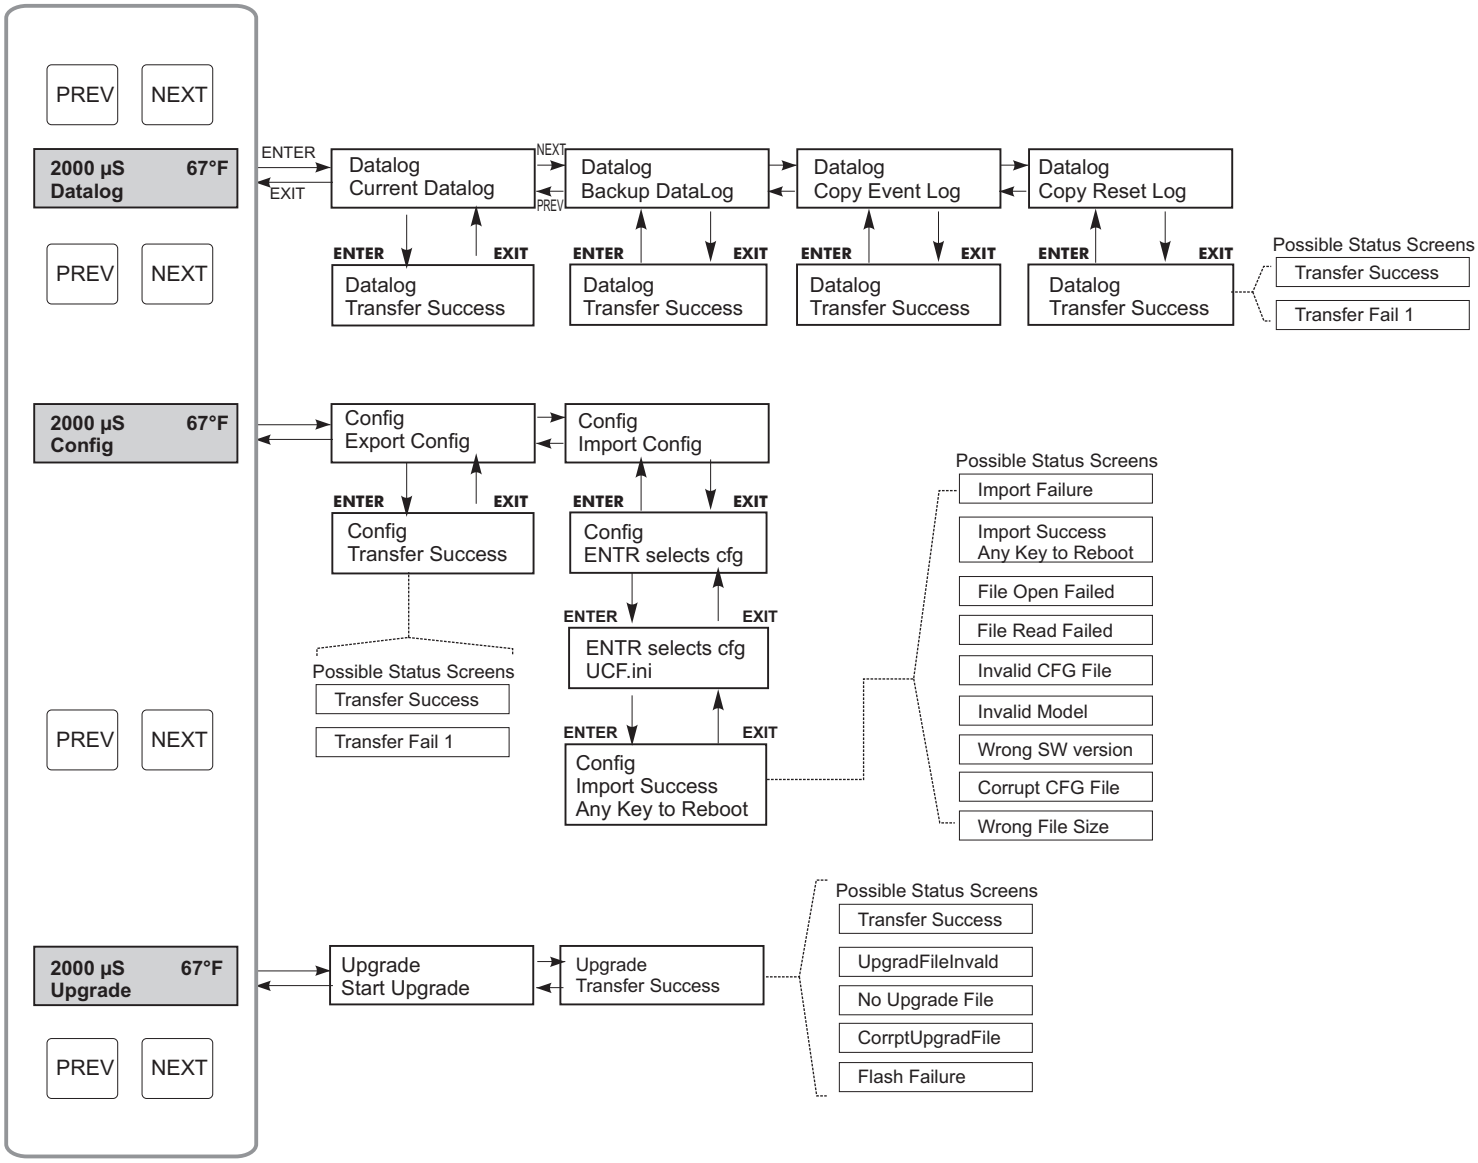


PREV
NEXT
2000 µS 67°F
Datalog
ENTER
EXIT
Datalog
Current Datalog
NEXT
PREV
Datalog
Backup DataLog
Datalog
Copy Event Log
Datalog
Copy Reset Log
ENTER
EXIT
Datalog
Transfer Success
Possible Status Screens
Transfer Success
Transfer Fail 1
2000 µS 67°F
Config
Config
Export Config
Config
Import Config
Config
Transfer Success
Config
ENTR selects cfg
ENTR selects cfg
UCF.ini
Config
Import Success
Any Key to Reboot
Possible Status Screens
Import Failure
Import Success
Any Key to Reboot
File Open Failed
File Read Failed
Invalid CFG File
Invalid Model
Wrong SW version
Corrupt CFG File
Wrong File Size
2000 µS 67°F
Upgrade
Upgrade
Start Upgrade
Upgrade
Transfer Success
Possible Status Screens
Transfer Success
UpgradFileInvald
No Upgrade File
CorrptUpgradFile
Flash Failure